


Generic Lighting Modifications

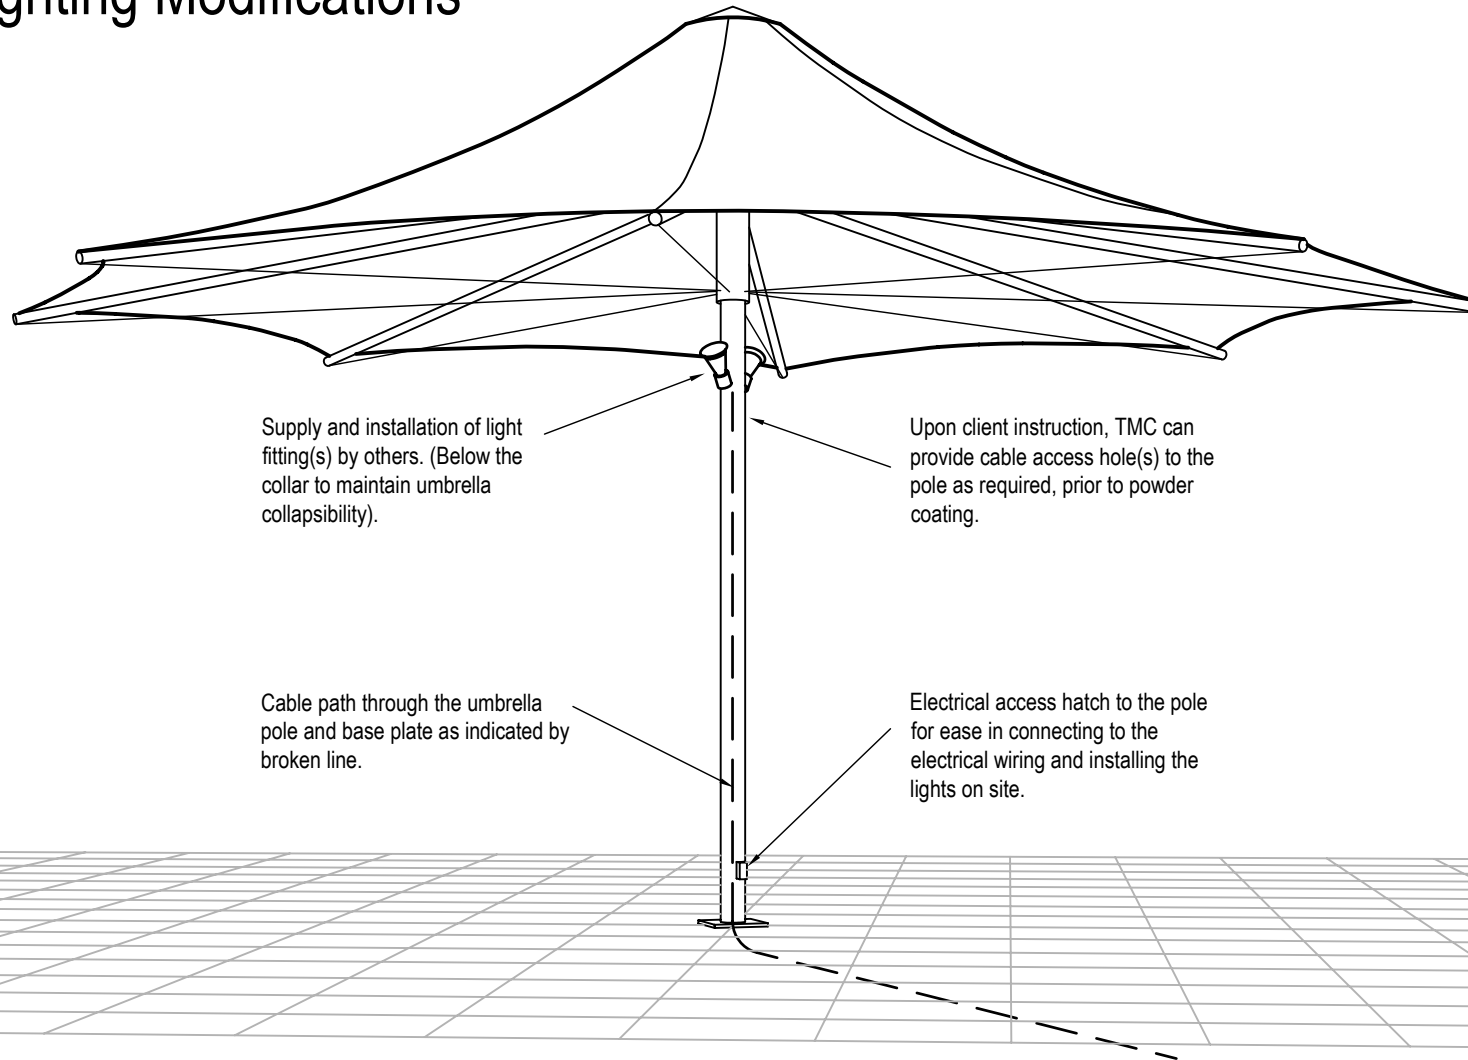

Supply and installation of light fitting(s) by others. (Below the collar to maintain umbrella collapsibility).

Upon client instruction, TMC can provide cable access hole(s) to the pole as required, prior to powder coating.

Cable path through the umbrella pole and base plate as indicated by broken line.

Electrical access hatch to the pole for ease in connecting to the electrical wiring and installing the lights on site.

Typical Lighting Arrangement